



**NOTES:**

1. PROVIDE 6" OF AASHTO NO. 8 (OR PennDOT NO. 1B) STONE BELOW AND ON EITHER SIDE OF PIPE AND 12" ABOVE ENTIRE LENGTH OF PIPE.
2. TANK TO BE BEDDED ON 6" OF AASHTO NO. 8 (OR PennDOT NO. 1B) STONE.
3. 50 FT MAX BETWEEN CLEANOUTS.
4. CLEANOUT COVER SHALL BE PVC IN UNPAVED AREAS AND CAST IRON IN PAVED AREAS.

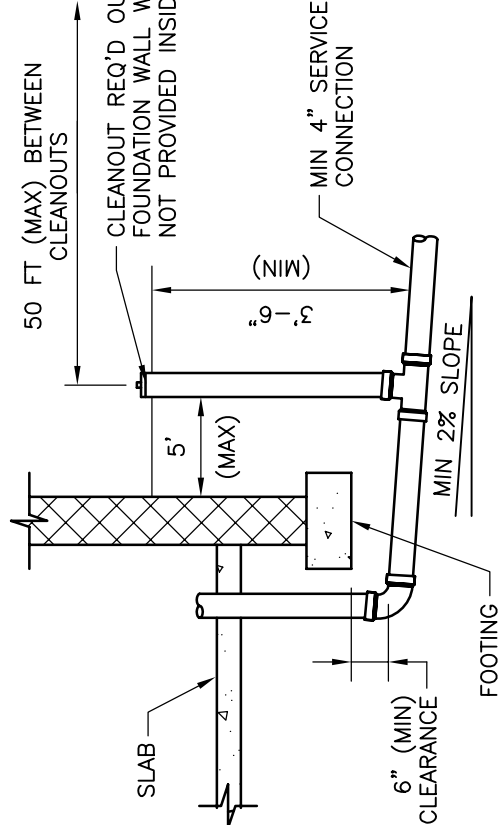

**TYPICAL LOW-PRESSURE SERVICE LINE TO LOW-PRESSURE SEWER MAIN OR FORCE MAIN**

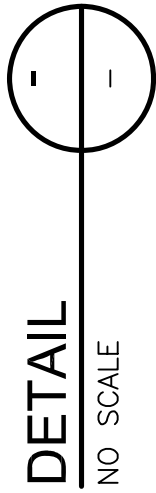

**DETAIL**

NO SCALE