


NOTES:

1. FIBERGLASS BASINS MAY NOT BE USED IN AREAS SUBJECT TO TRAFFIC LOADING.
2. LOCATION OF BASIN TO BE DETERMINED BY PROPERTY OWNER OR DEVELOPER.
3. EXCAVATED AREA SHALL BE BACKFILLED TO 6" BELOW GRADE. BACKFILL MATERIAL SHALL BE EXCAVATED MATERIAL CONTAINING NO SOIL LUMPS, STONES, CONCRETE, OR FOREIGN OBJECTS LARGER THAN 1" MAX DIMENSION, OR AASHTO No. 8 STONE.
4. 6" TOPSOIL AND SEED SHALL BE PLACED TO GRADE THE SURROUNDING EXCAVATED AREA.
5. TYPICAL TANK SIZE FOR 1 EDU IS 36" DIA x 96".
6. PROVIDE A REDUNDANT CHECK VALVE ON PUMP DISCHARGE PIPING.

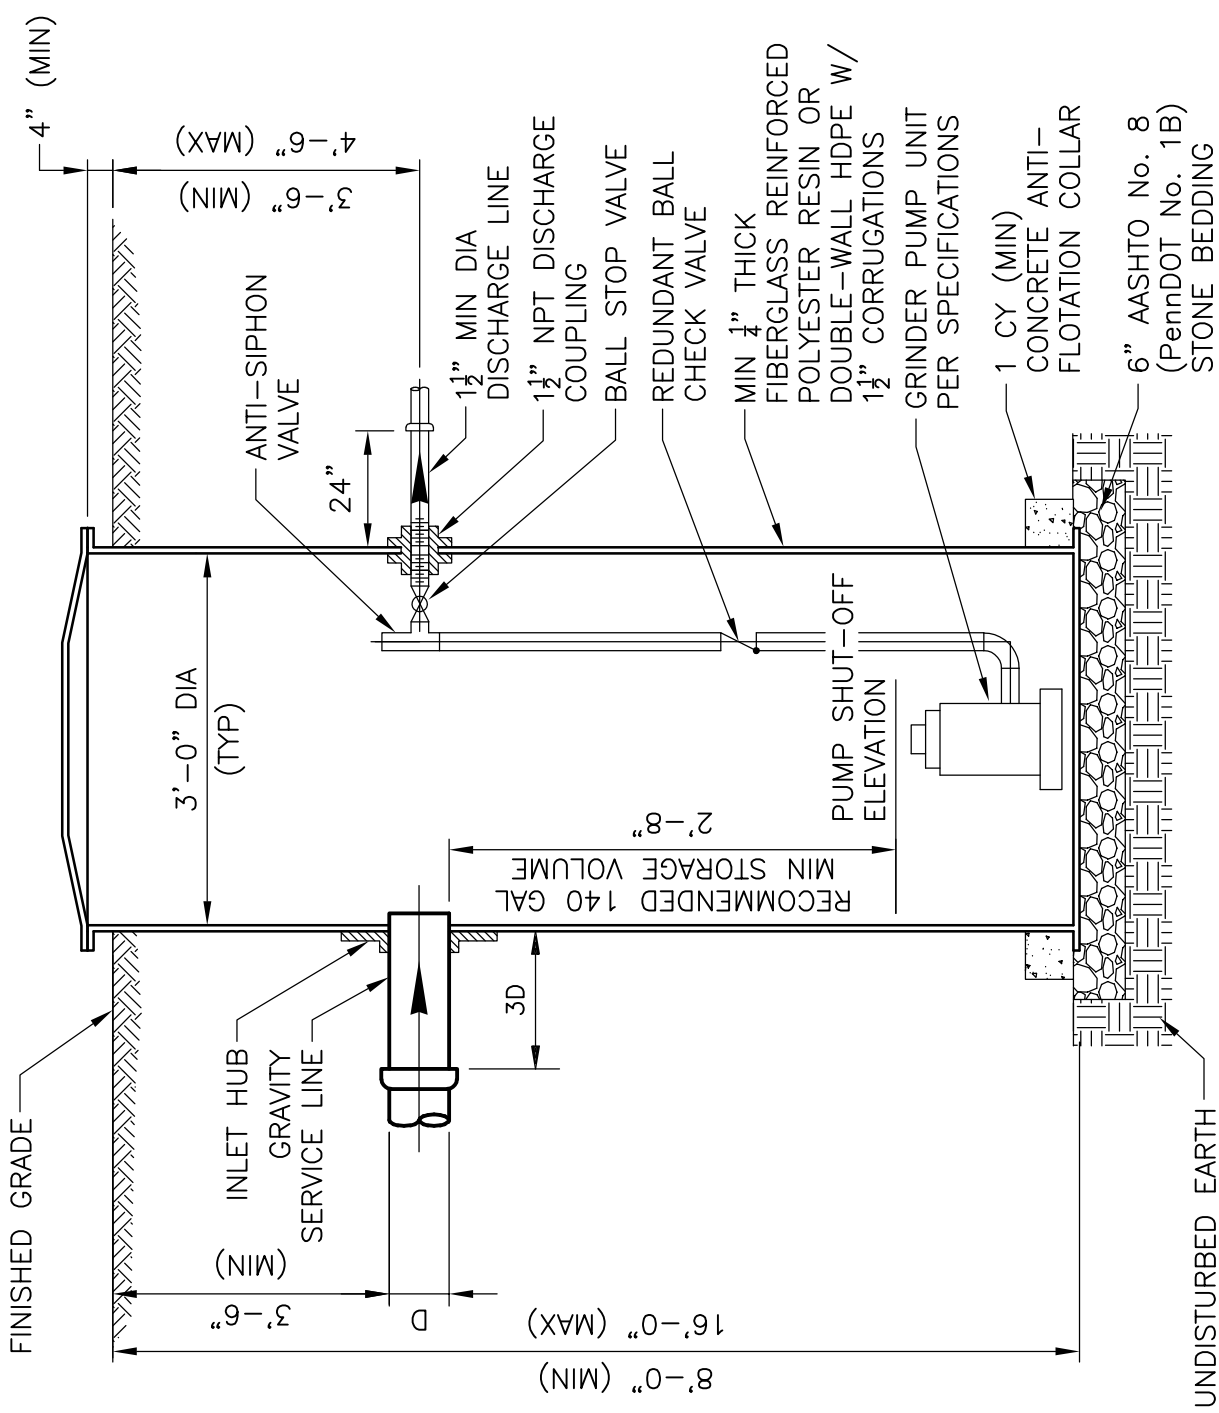

**FIBERGLASS OR HDPE BASIN
FOR TYPICAL INDIVIDUAL PUMP**

DETAIL
NO SCALE